


THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. NO USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED, UNLESS THE PLANS AND SPECIFICATIONS REMAINS WITH THE CONTRACT. WITHOUT LIMITING THE REMAINING, VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE PERMANENT PERMISSION. CONTRACTOR TO OBTAIN CLARIFICATION FROM ENGINEER OF RECORD WHERE CONFLICTS IN DRAWING OR DIMENSIONS ARISE PRIOR TO PROCEEDING WITH CONSTRUCTION.

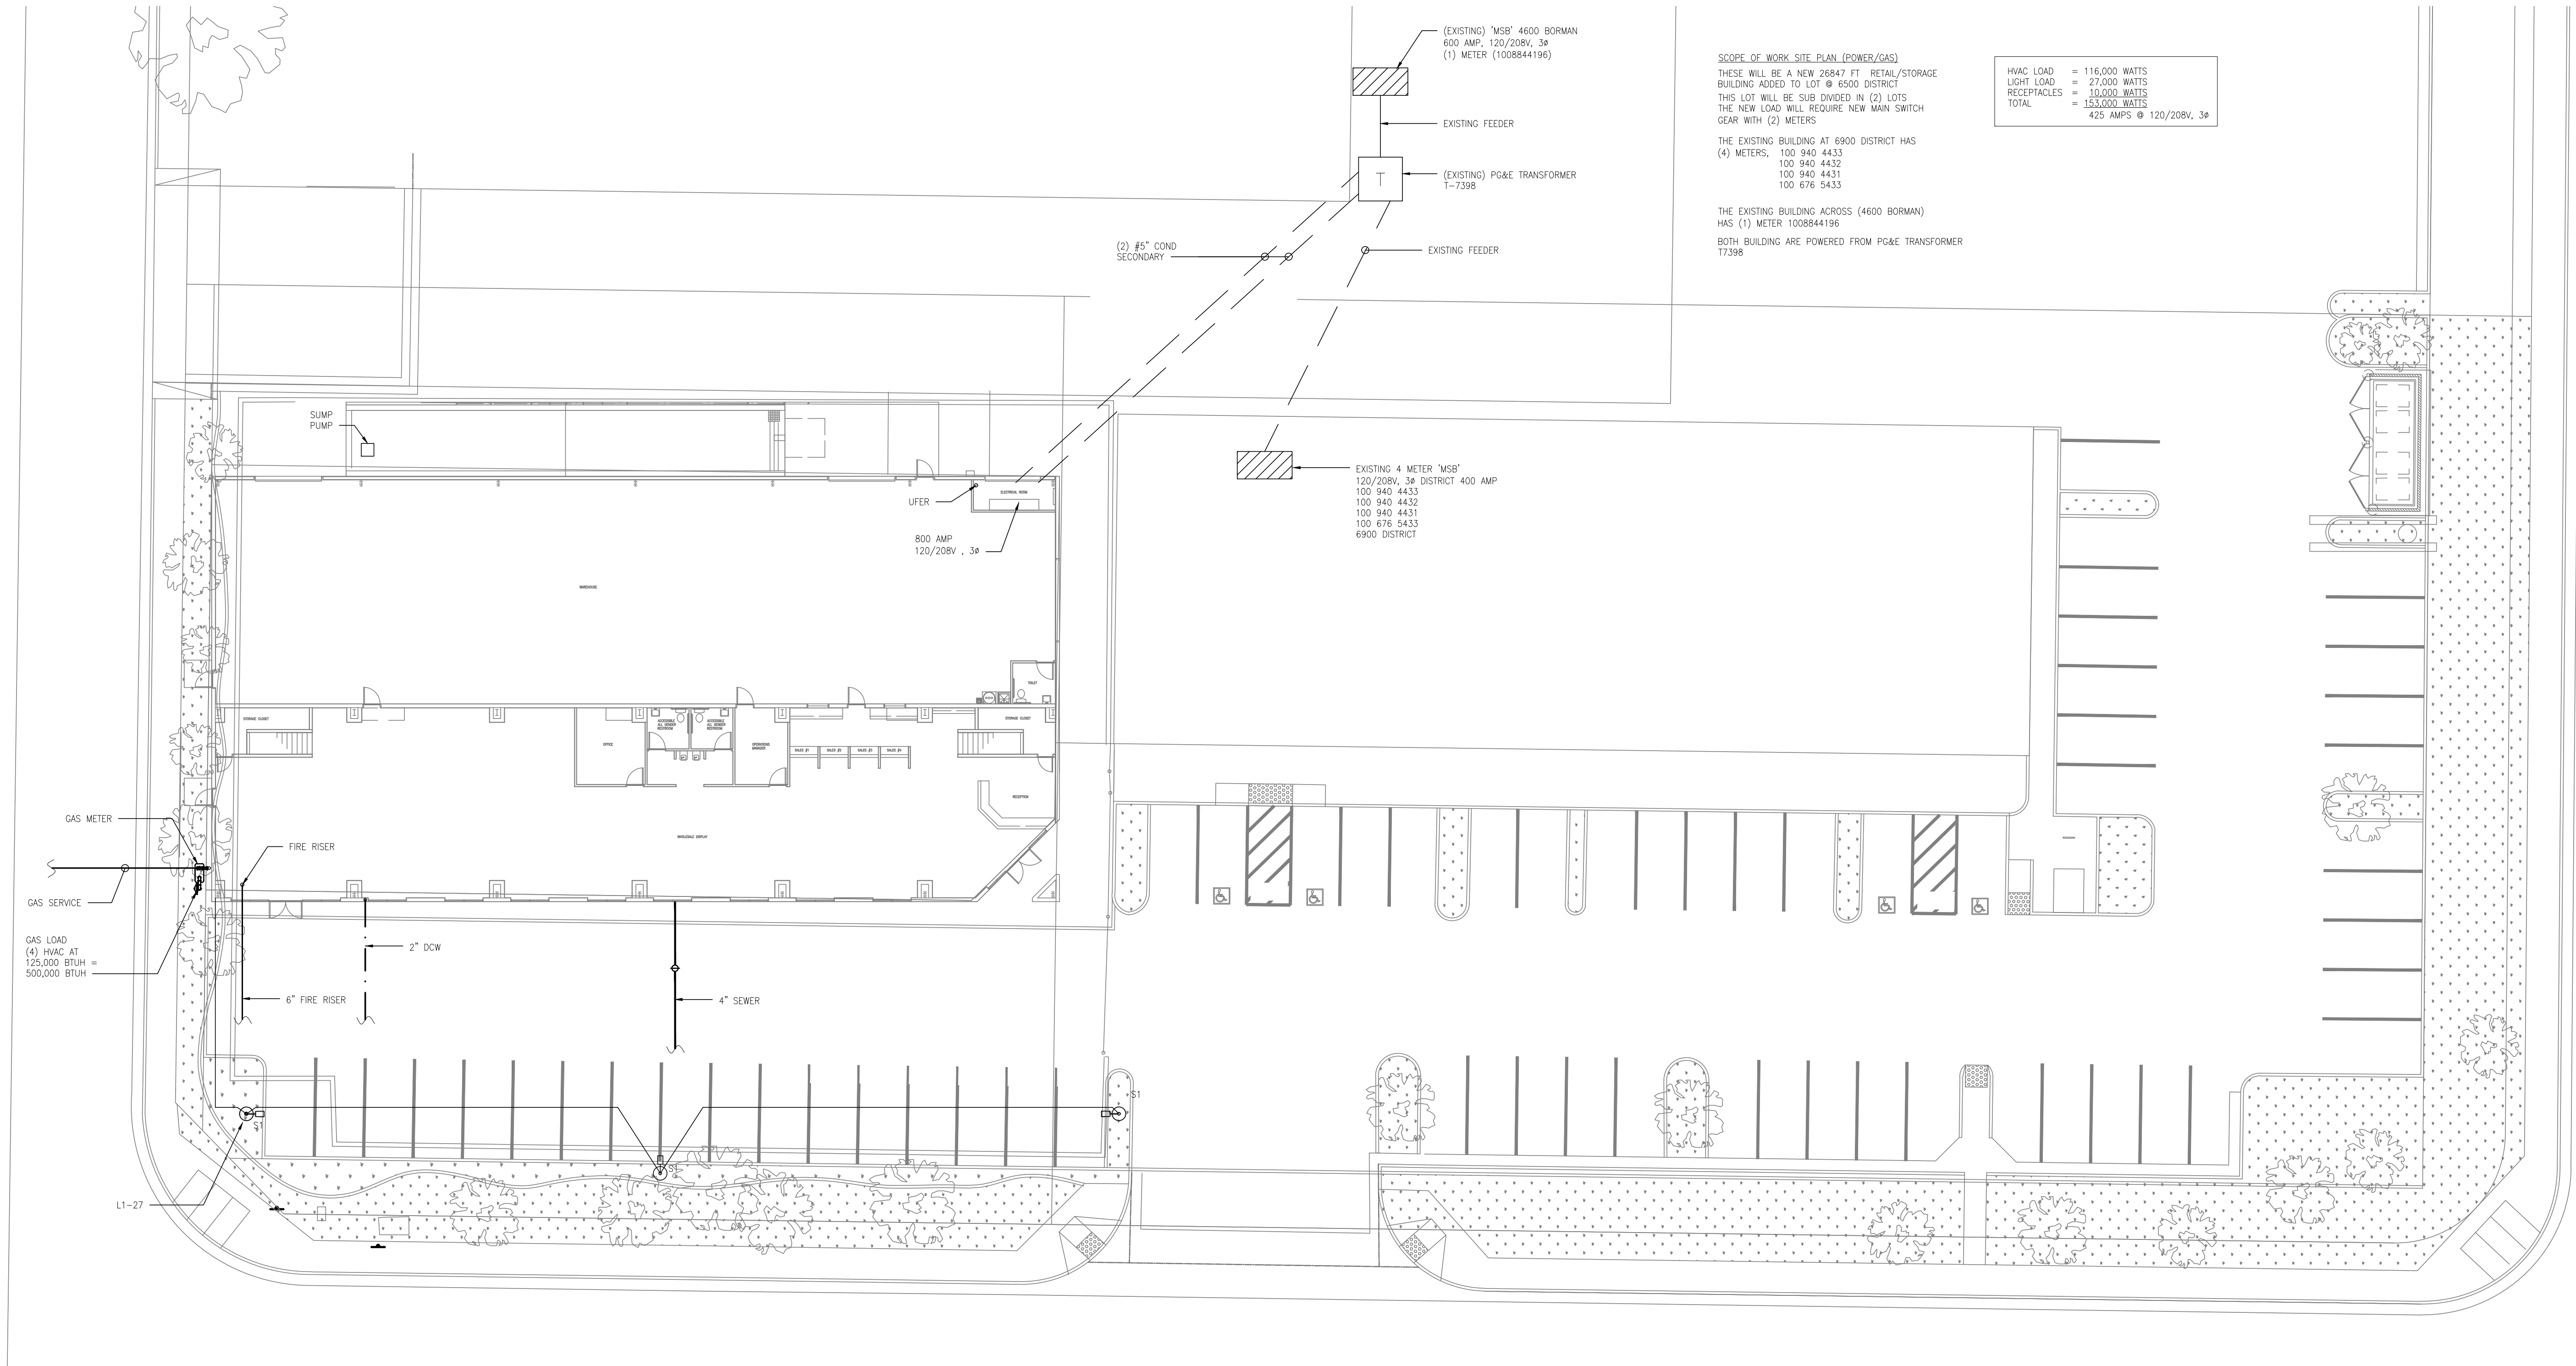

SITE UTILITY PLAN

SCALE: 1/16" = 1'-0"

SCOPE OF WORK: SITE PLAN (POWER/GAS)
THESE WILL BE A NEW 26847 FT. RETAIL/STORAGE BUILDING ADDED TO LOT # 6500 DISTRICT
THIS LOT WILL BE SUB DIVIDED IN (2) LOTS
THE NEW LOAD WILL REQUIRE NEW MAIN SWITCH GEAR WITH (2) METERS
THE EXISTING BUILDING AT 6900 DISTRICT HAS
(4) METERS, 100 940 4433
100 940 4432
100 940 4431
100 676 5433

THE EXISTING BUILDING ACROSS (4600 BORMAN) HAS (1) METER 1008844196
BOTH BUILDING ARE POWERED FROM PG&E TRANSFORMER T-7398

HVAC LOAD	=	116,000 WATTS
LIGHT LOAD	=	27,000 WATTS
RECEPTACLES	=	10,000 WATTS
TOTAL	=	153,000 WATTS
		425 AMPS @ 120/208V, 3Ø


(2) #5" COND SECONDARY

EXISTING 4 METER 'MSB'
120/208V, 3Ø DISTRICT 400 AMP
100 940 4433
100 940 4432
100 940 4431
100 676 5433
6900 DISTRICT

(EXISTING) 'MSB' 4600 BORMAN
600 AMP, 120/208V, 3Ø
(1) METER (1008844196)

(EXISTING) PG&E TRANSFORMER
T-7398

EXISTING FEEDER

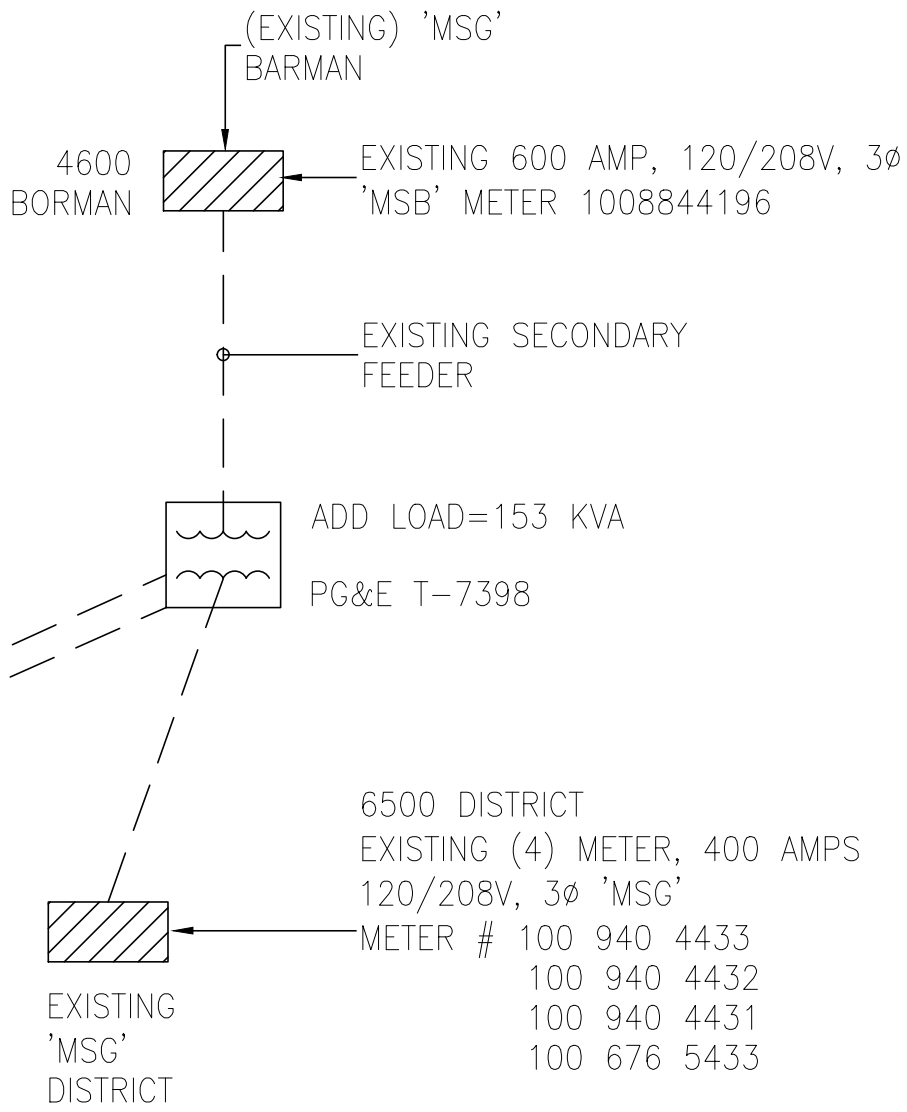

CANTELM ENGINEERING
MECHANICAL/ELECTRICAL
2130 STREET BAKERSFIELD, CA 93301
TEL: (661) 324-3252 FAX: (661) 324-8439 Contelmi@Contelmi.NET

MICHAEL FLOORING, INC.
6500 DISTRICT BLVD.
BAKERSFIELD, CA 93313

DATE	ISSUED

DATE	MARK	ISSUED

DWG. BY	-
CHKD BY	-
DATE	-
JOB NO.	C14***
FILE NO.	C18-136 EPS-1.DWG

SHEET
EPS-1
X OF X
SHEET